


GENERAL NOTES

- 1 CONTRACTOR TO VERIFY ALL EXISTING HVAC PRIOR TO DO ANY NEW WORK.

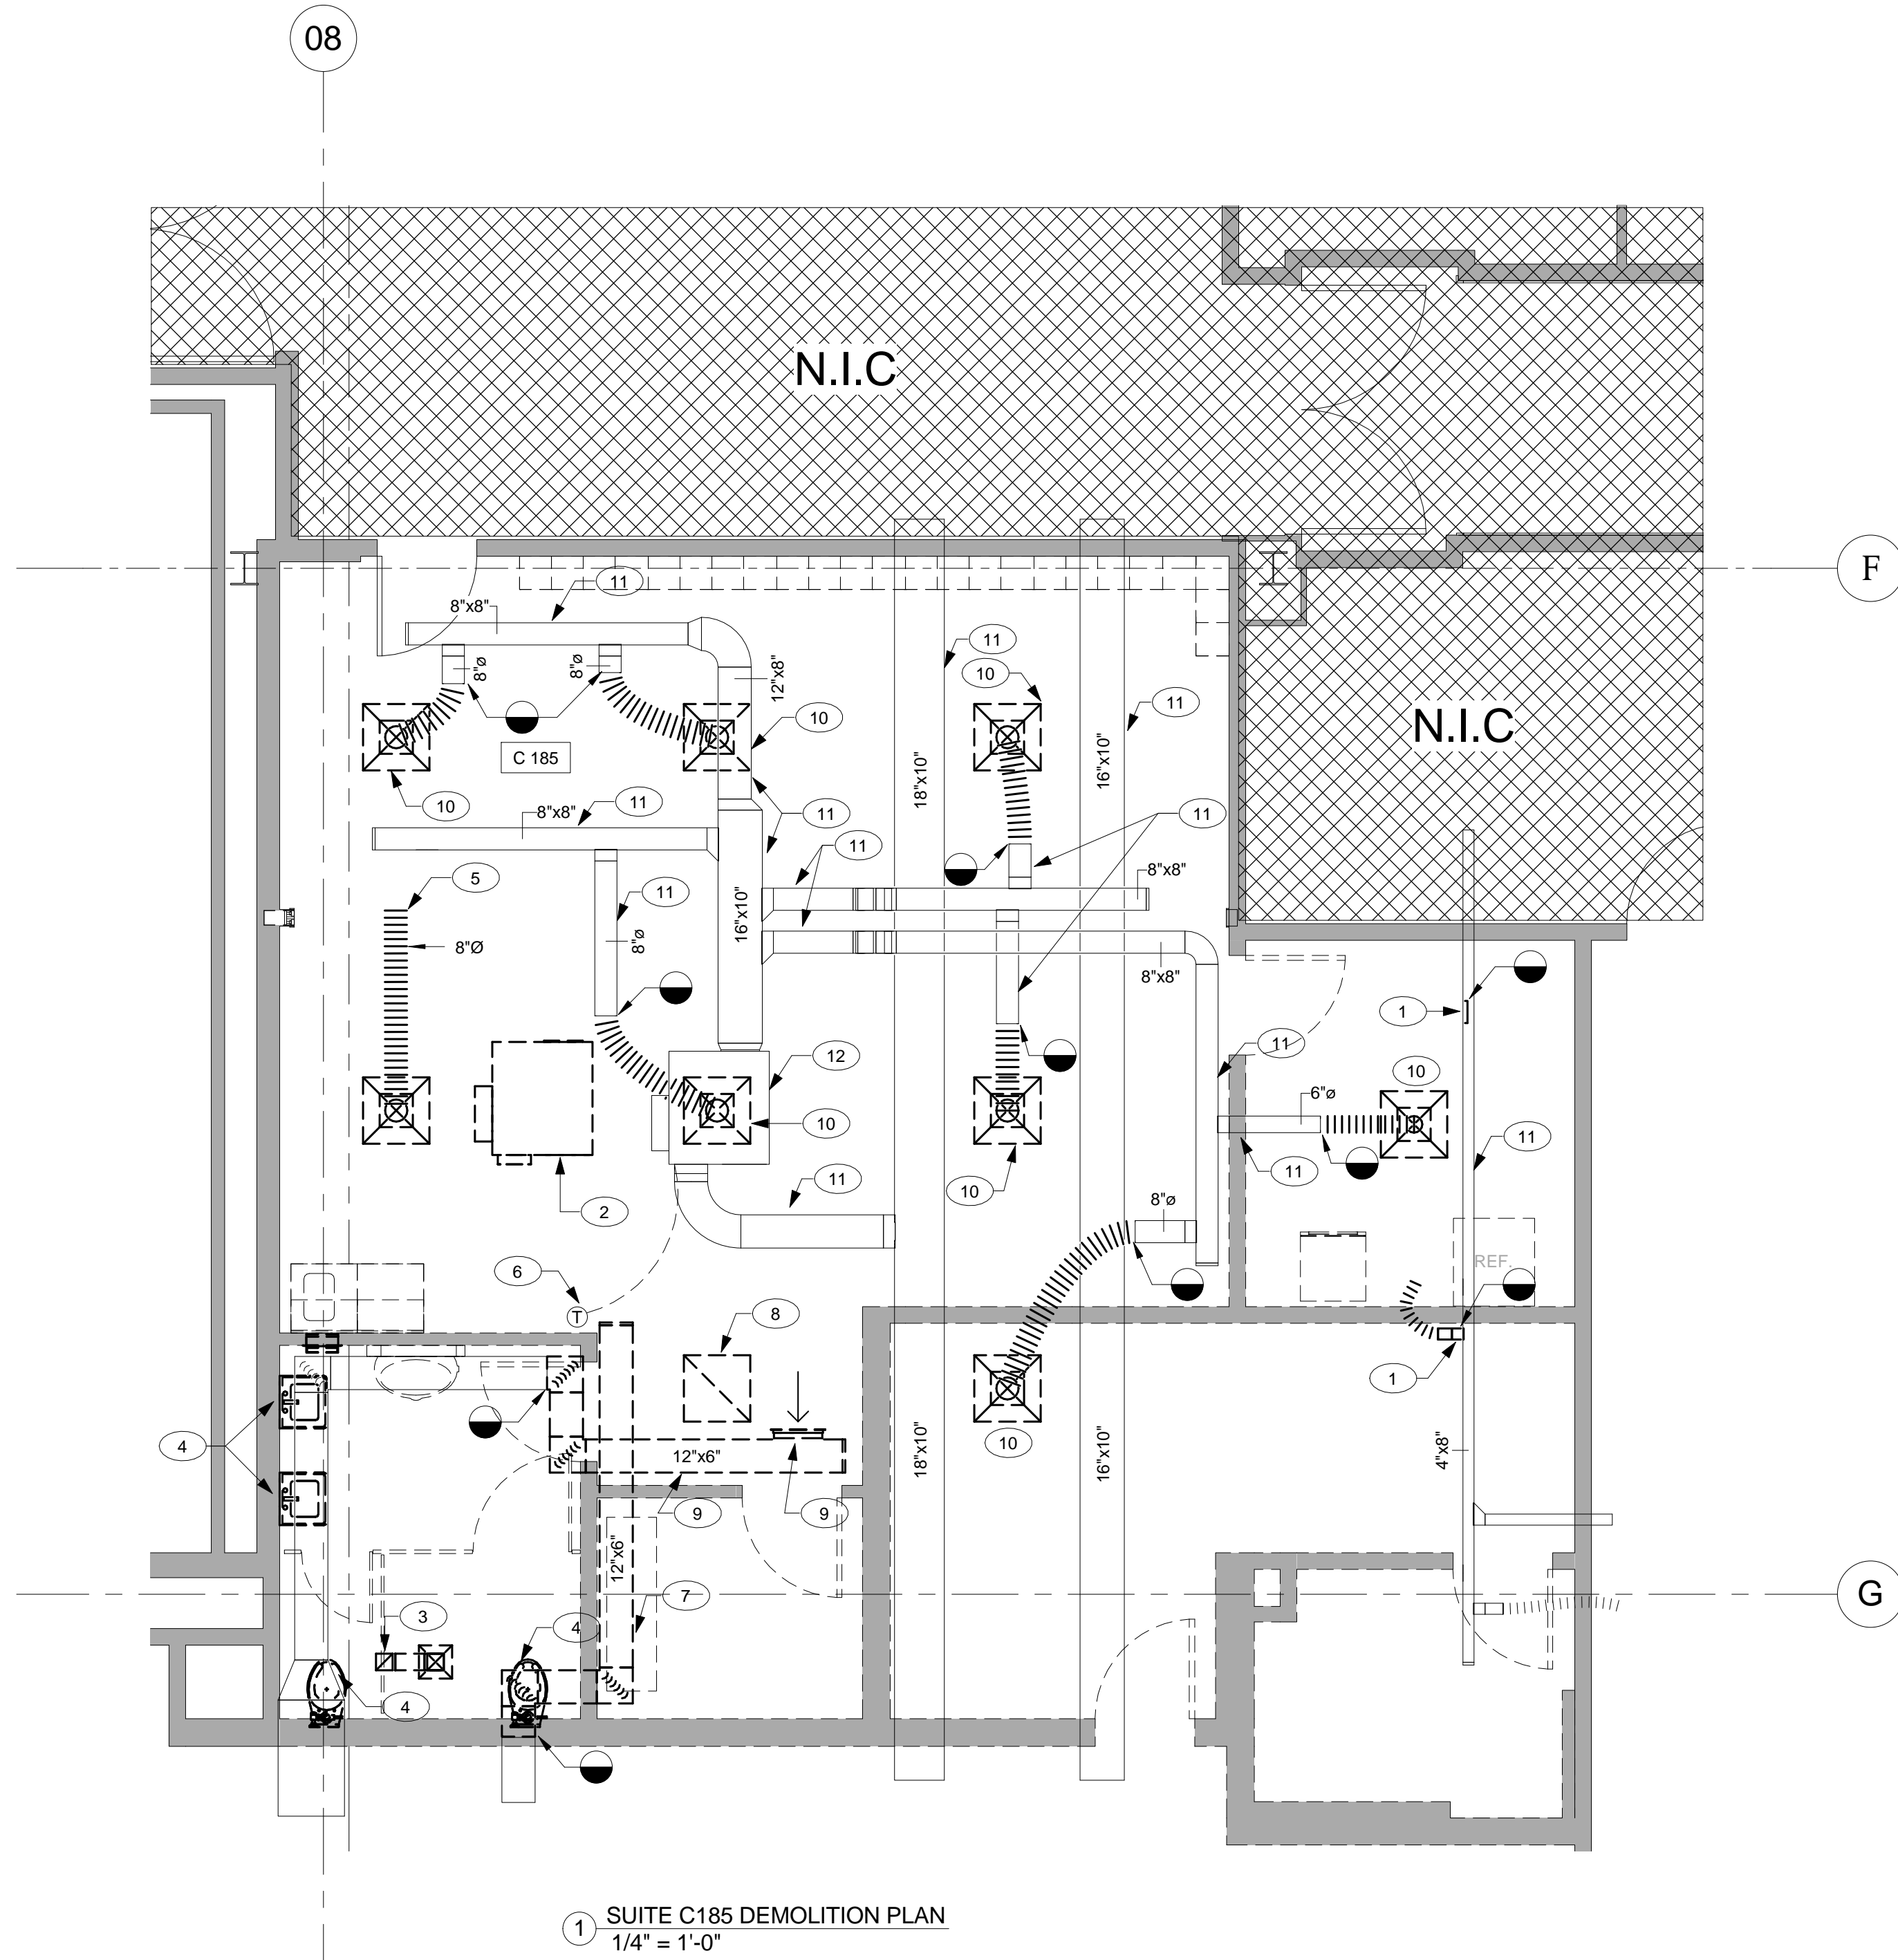

DEMOLITION PLAN NOTES


- 1 OPENING IN DUCT TO BE SEALED AND CLOSED.
2 DEMOLISH EXISTING HVAC EQUIPMENT AND ASSOCIATED PIPING & DUCTWORK.
3 EXHAUST FAN AND ASSOCIATED DUCTS TO BE DEMOLISHED.
4 EXISTING COLD WATER, HOT WATER & HWR TO BE CAPPED ABOVE THE CEILING OR BEHIND THE WALL.
5 UN-CONNECTED FLEX DUCT TO BE DEMOLISHED & EXISTING AIR DEVICE TO BE RELOCATED.
6 EXISTING THERMOSTAT TO BE RELOCATED, SEE NEW WORK.
7 EXISTING DUCT TO BE DEMOLISHED TILL WHERE IS SHOWN.
8 EXISTING RETURN AIR DEVICE TO BE DEMOLISHED.
9 RETURN DUCT TO BE CUT BACK WHERE IS SHOWN AND RETURN GRILL TO BE MOVED. SEE NEW WORK.
10 EXISTING SUPPLY AIR DEVICE TO BE RELOCATED.
11 EXISTING SUPPLY DUCT TO REMAIN.
12 EXISTING VAV TO REMAIN.

NEW WORK PLAN NOTES

- A CONTRACTOR TO INSTALL NEW 8" BRANCH DUCT AND FLEX AND RE-CONNECT BACK TO EXISTING SUPPLY AIR DEVICE.
B CAP EXISTING DUCT.
C EXISTING RETURN GRILL TO BE MOVED BACK TO WHERE INDICATED.
D NEW LOCATION OF THE EXISTING AIR DEVICE.
E NEW RETURN AIR DEVICES TO BE INSTALLED.
F CONTRACTOR TO EXTEND EXISTING 8" DUCT & BALANCE THE DAMPER TO RAED 200 CFM FROM THIS AIR DEVICE.
G NEW LOCATION OF THE EXISTING THERMOSTAT.
H NEW TRANSFER DUCT TO BE INSTALLED.

NEW AIR DEVICE SCHEDULE

MARK	SYSTEM	MANUFACTURER & MODEL NO.	REMARKS
	TYPE		
A	RETURN	"TITUS" MODEL NO. "PAR", ALL STEEL CONSTRUCTION, PERFORATED FACE WITH BACKPAN AND NECK SIZE PER DRAWINGS, 2x2' LAY-IN WITH RADIATION DAMPER.	FURNISH IN WHITE POWDER COAT FINISH.
	SUPPLY	"TITUS" MODEL NO. "PAS", ALL STEEL CONSTRUCTION, 2x2' LAY-IN FURNISH WITH PERFORATED FACE AND 1 TO 4 WAY DISCHARGE PATTERN. SUPPLY WITH RADIATION DAMPER	FURNISH IN WHITE POWDER COAT FINISH.

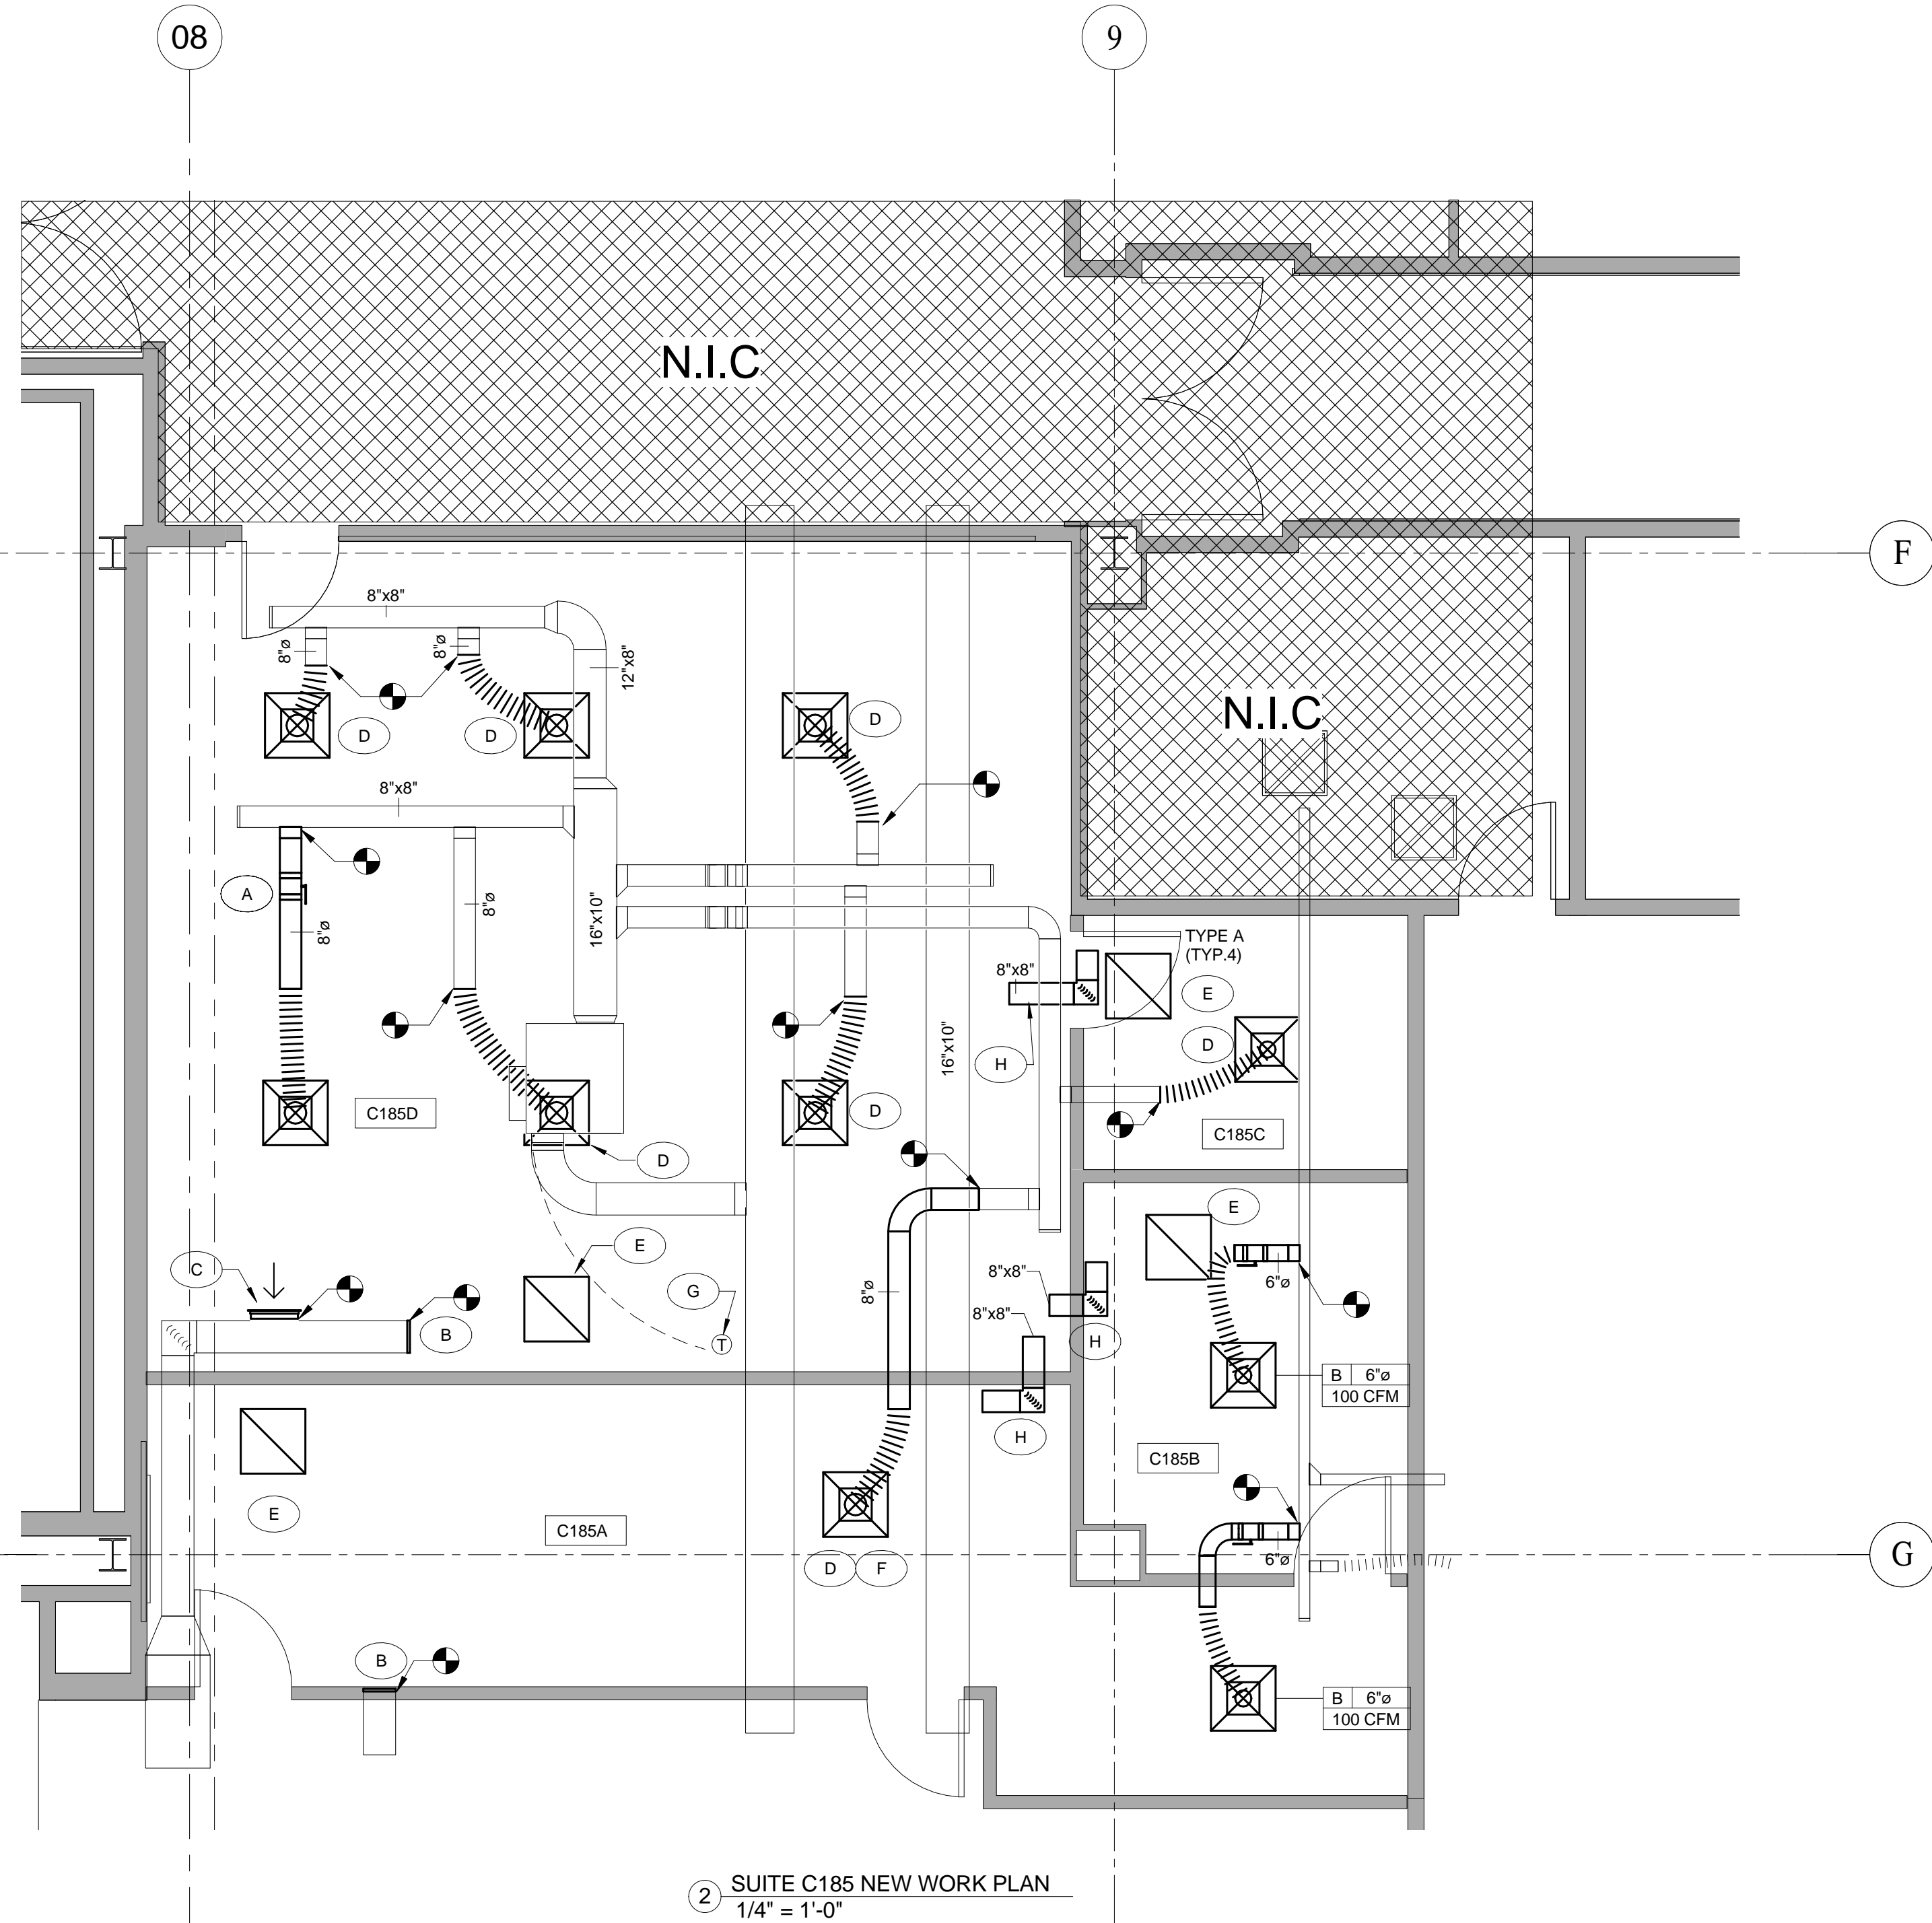

APPROVAL STAMP

CLIENT NAME & LOGO

ARCHITECT & ENGINEER NAME & LOGO

PROJECT

KEY PLAN

SUBMISSION


REVISIONS

SHEET



Juror's Lounge and Public Restrooms

Enter address here



IBI GROUP
Architects, Planners & Interior Designers
1505 Prince Street - Suite 200
Alexandria VA 22314-2852 USA
tel 703.836.9600 fax 703.836.2484
ibigroup.com

Mechanical / Electrical / Plumbing Engineer
SRBR Engineers Inc.
757 Frederick Road Suite 300
Catonsville, MD 21228
tel 410.869.7282

Construction Documents for
Interior Improvement to:
C Street Renovation-Suite C
-185 Modification

District of Columbia Courts
Capitol Projects and Facilities
Management Division

Washington DC 2001

Project Title
Client Name
Building Address

ISSUED FOR
ISSUED FOR PERMIT
DATE
11/08/2019

APPROVALS
DATE

NO.
DESCRIPTION
DATE
BY

This drawing and the design shown hereon are the property of IBI Group. The reproduction, copying, or other use of the drawing without their written consent is prohibited and any infringement will be subject and any infringement will be subject to legal action.

Accepted By:

Capital Projects and Facilities Management Officer
Contracting Officer
District of Columbia Courts

C Street Level Renovation - Suite
C-185 Modification
FLOOR PLAN - SUITE C185 - C STREET
LEVEL

Date: 11/08/19
Scale: 1/4" = 1'-0"
Checked by: Checker
Drawn by: Author
Planned By: Designer



Project Number

M-20